



FORT LOUDOUN ELECTRIC COOPERATIVE

Specification For Member Dug Underground Primary


No water, sewer, or gas lines are to be installed in the same ditch with any electrical lines.

Phone and or cable lines may be installed in ditch, but must be installed above the red CAUTION tape with at least two foot of separation.


Information and Requirements for Member Dug Underground Primary

- * Once a FLEC Engineering Services Department member visits site, the aid of construction fee will be given which must be paid in full before any materials can be delivered or work performed on site.
- * Once fees are paid, job will be released to FLEC warehouse and a FLEC employee will be in contact to schedule delivery of any conduit, boxes or vaults.
- * **Primary ditch is to be dug at least 4 1/2 feet deep from final grade level.**
- * **Ditch is to be at least 1 foot wide.**
- * Ditch must be inspected prior to backfill.
- * After ditch has been backfilled half-way, a red "CAUTION" tape must be placed in the ditch before it can be closed.
- * If Junction Boxes are required, 4 inches of crushed stone must be installed as a base.
- * 6 inches of crushed stone must be installed as a base for the Transformer Vault.
- * If by chance proper depth can not be dug, encasement in concrete might be required.

PROFILE VIEW

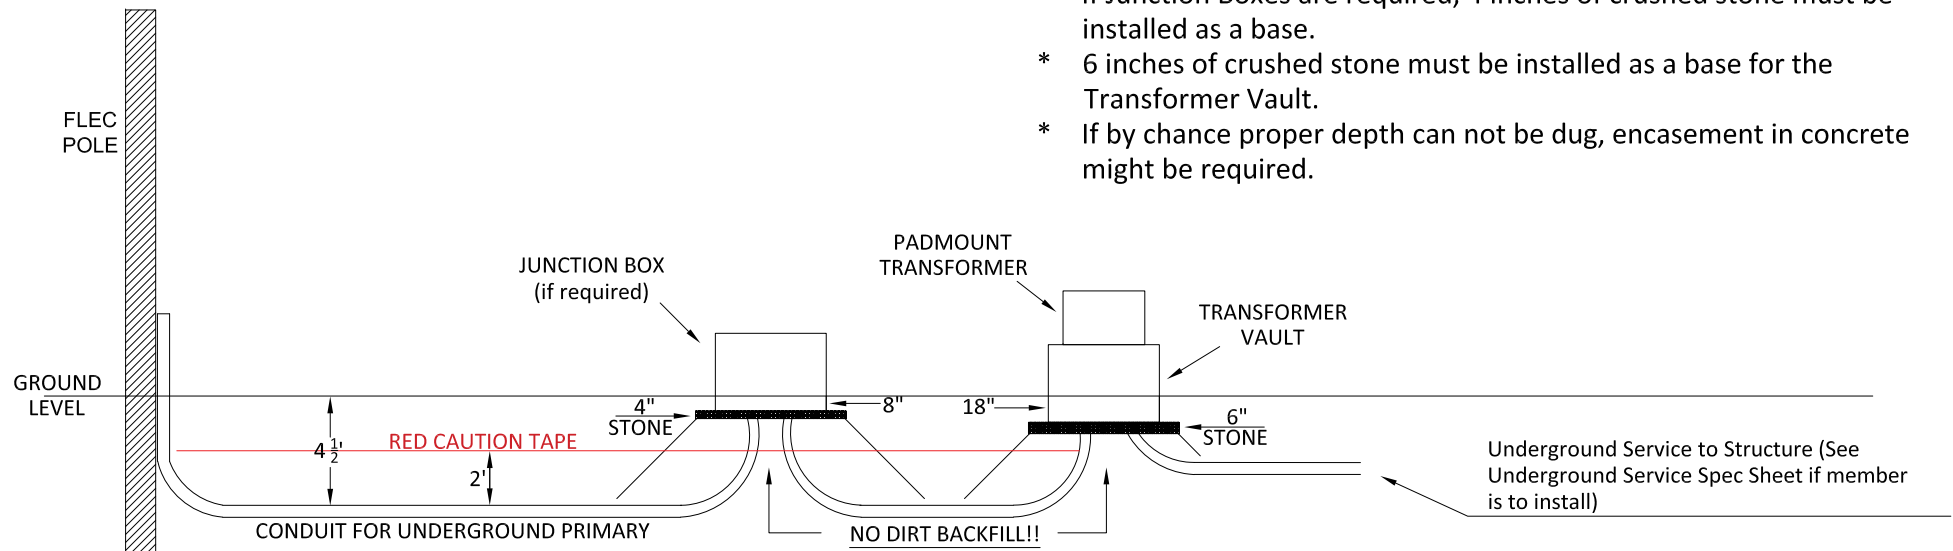

PLAN VIEW

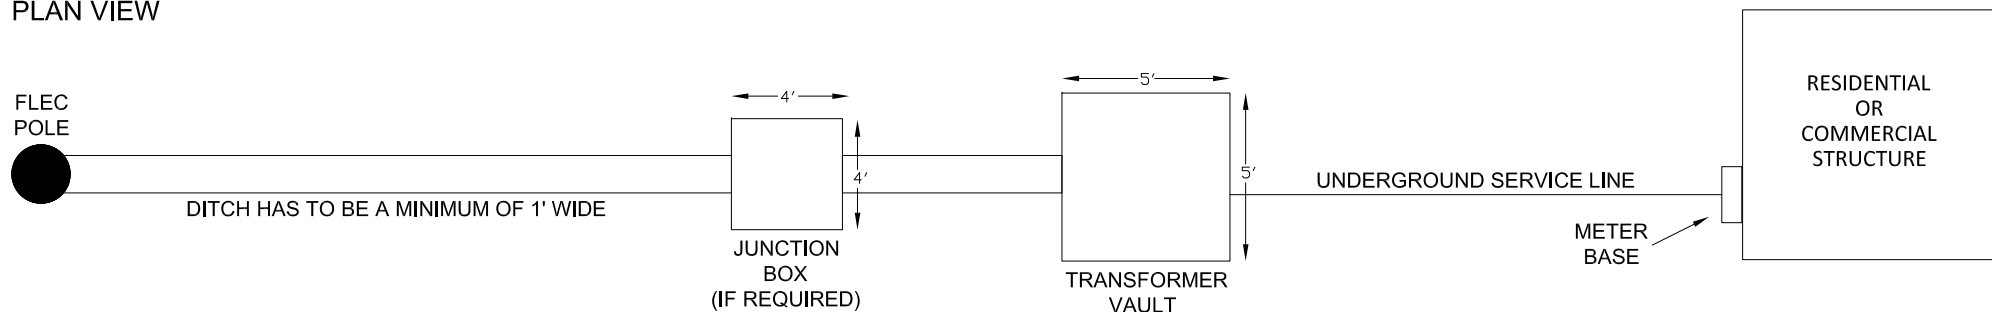

FLEC IS A MEMBER OF THE TENNESSEE 811 SYSTEM.

REMEMBER TO CALL 811 TO REQUEST ANY UNDERGROUND UTILITIES TO BE MARKED BEFORE YOU DIG!